

7418
Return completed forms to:

Wisconsin Department of Natural Resources
Bureau of Drinking Water & Groundwater - DG/5
PO Box 7921, Madison, WI 53707-7921
dnr.wi.gov

prop. 9753

RECEIVED-DNR
High Capacity, School or Wastewater Treatment Plant
Well Approval Request

Form 3300-295 (R 5/15)

JUL 13 2016

Page 1 of 4

Notice: Pursuant to §§ NR 812.09(4)(a) & (b), Wis. Adm. Code, prior Department of Natural Resources (DNR) approval is required for the construction, reconstruction or operation of a high capacity well or system of high capacity wells, a school well or a wastewater treatment plant well. This form is required to be completed to request approval for installation of a well or wells on a high capacity property, to modify a well on a high capacity property, or the construction or reconstruction of a school or wastewater treatment plant well. Personally identifiable information collected will be used for administrative purposes and may be provided to requesters to the extent required by Wisconsin's Open Records law (s.19.31-19.39, Wis. Stats.).

Applicant Information

Name and Title JEFF HAUPT		Company HAUPT WELL DRILLING INC.	
Street Address P.O. BOX 136		City AUBURNDALE	State WI
Phone Number (include area code) 715-652-2236	Fax Number 715-652-8014	Email Address	
ZIP Code 54412			

Owner Information (if different than applicant)

Name and Title SCHUH FARMS INC.		Company CONTACT: JOE SCHUH	
Street Address W26787 SCHUH ROAD		City TREMPEALEAU	State WI
Phone Number (include area code) 608-534-6538	Fax Number CELL 608-792-4337	Email Address	
ZIP Code 54661			

Operator Information (if different than owner)

Name and Title		Company	
Street Address		City	State
Phone Number (include area code)	Fax Number	Email Address	
ZIP Code			

Submittal Purpose

Check all that apply

- Non-Potable Well(s) Potable Well(s) Requires Potable Attachments
- Install one or more new wells with a capacity greater than 70 gallons per minute.
- Install one or more new wells with a capacity less than 70 gallons per minute on a high capacity property.
- Replace one or more wells with a capacity greater than 70 gallons per minute.
- Replace one or more wells with a capacity less than 70 gallons per minute on a high capacity property.
- Reconstruct one or more wells with a capacity greater than 70 gallons per minute.
- Reconstruct one or more wells with a capacity less than 70 gallons per minute on a high capacity property.
- Increase pumping rate in one or more wells to a rate greater than previously approved.
- Renew a previous approval that has expired.
- Other (please describe: School, WWTP etc.) _____

Project Description

Provide a brief description of the proposed project including the number of potable wells to be installed. For non-potable wells include number of acres and expected crop rotation for agricultural irrigation wells. For potable wells serving livestock note if the facility is currently or plans to become a concentrated animal feeding operation (CAFO).

NON POTABLE IRRIGATION WELL TO IRRIGATE INITIALLY APPROX 40ACRES
WITH POTENTIAL TO IRRIGATION 80 TOTAL. CORN & ALFALFA ROTATION.

Required Enclosures

- High Capacity Well Application (Form 3300-295)
- \$500 application fee (see s. 281.34 (2), Wis. Stats.)
- Well Construction Reports (if available) for existing wells
- Potable Attachment: if a proposed well is potable (Form 3300-295A)
- Aerial or Plat Map with property boundaries outlined
- Variance Request, if needed (Form 3300-210)

Return completed forms to:

State of Wisconsin, Department of Natural Resources
 Bureau of Drinking Water & Groundwater – DG/5
 PO Box 7921, Madison, WI 53707-7921
dnr.wi.gov

High Capacity, School or Wastewater Treatment Plant Well Approval Request

Form 3300-295 (R 5/15)

This form is used to request an approval for the construction or reconstruction of a well or wells on a high capacity property, to modify an existing well on a high capacity property, or the construction or reconstruction of a school or wastewater treatment plant well. The following information will be scanned and posted as a public record on our website. Return completed application to:

Wisconsin Department of Natural Resources
 Bureau of Drinking Water & Groundwater - DG/5
 PO Box 7921
 Madison, WI 53707-7921

Applicant Information

Name and Title: **JEFF HAUPT** Company: **HAUPT WELL DRILLING INC.**

Owner Information

Name and Title: **SCHUH FARMS INC.** Company: **CONTACT: JOE SCHUH**

County: **TREMPEALEAU** Town: **18 N** Range: **9** East West Section: **8** High Capacity Well File No. (if applicable): **62-1-48**

- Yes No
- Is a proposed well within 1,200 feet of a landfill? Landfill location: (Township/Range/Section): T R S
 - Are you aware of any existing well installations on the high capacity property that are out of compliance with Chapter NR 812, Wisconsin Administrative Code? If yes, attach a description of the non-complying wells.

Existing Well Information

Enter the following information for all existing wells on the property and any contiguous property owned by the applicant.
Note: Applications are not complete unless they specify water use, pump capacities and GPS locations of existing wells.

Well Name and/or Number assigned by Owner	Water Use Code(s)	High Capacity Well Number	Pump Capacity (gpm)	Existing Well Coordinates Decimal Degrees Preferred (e.g. 45.1234, -89.1234)		WUWN or WCR Image File # (if known)
				Latitude	Longitude	
IRIGATION #1	IR10	67499	1000	44.0494	-91.4920	SZ 865
JOE'S HOUSE	DS11	67498	20	44.0457	-91.4873	TR632.TIF
MAIN FARM	DS11	67497	20	44.0468	-91.4891	TR633.TIF

Additional Project Information

Include any additional relevant information regarding this project such as existing wells to be abandoned, proposed non-standard construction methods or pending ownership changes

High Capacity, School or Wastewater Treatment Plant Well Approval Request

Form 3300-295 (R 5/15)

Page 4 of 4

Proposed Well Information

Enter the following information for all proposed wells on the property. If more than two wells or alternate construction, submit additional sheets.

Well Location and Usage		<input type="radio"/> Potable	<input checked="" type="radio"/> Non-Potable	<input type="radio"/> Potable	<input type="radio"/> Non-Potable
Well Name Assigned by Well Owner (North Well, etc.):	91802				
Town/Range/Section:	SE 1/4 SW 1/4 S 8 T 18 R 9 W	1/4	1/4 S	T	R
Latitude :	44.0458				
Longitude:	-91.4838				
Water Use Code (e.g. IR10):	IR10				
Proposed Maximum Water Usage Per Day in Gallons:	864,000				
Proposed Maximum Water Usage Per Month in Gallons:	25,920,000				
Months of Operation (e.g. May - Sept):	MAY - SEPTEMBER				
Proposed Pump Type & Capacity(gpm):	LINESHAFT TURBINE (600)				
Discharge Type (Over Top of Casing Seal, Pitless Adapter or Unit):	OVER TOP OF CASING SEAL				
Discharge Location (Building Pressure Tank, Pond, etc.):	TO CENTER PIVOT SYSTEM				
Distance and Direction to Nearest Public Utility Well & Well Name:	3+ MILES SE TO TREMPPEAU				
Distance to Other Potential Contaminant Sources:					

Well Construction

Drilling Method(s) (Rotary, Percussion, Etc.):	Reverse Rotary				
Anticipated Geological Materials and Depths that are expected during drilling:					
Material and Depth Interval:	SAND GRAVEL	from 0	' to 165'	from 0	' to
Material and Depth Interval:	CLAY	from	' to	from	' to
Material and Depth Interval:		from	' to	from	' to
Material and Depth Interval:		from	' to	from	' to
Drillhole Diameter and Anticipated Depth Intervals:					
Diameter and Depth Interval:	17"	from 0	' to 165'	from 0	' to
Diameter and Depth Interval:		from	' to	from	' to

Permanent Casing or Liner Material , If Used:


Diameter and Wall Thickness:	12.75 dia .25" thick	from 0	' to 135'	" dia	" thick	from 0	' to
Diameter and Wall Thickness:	" dia	" thick	from	' to	" dia	" thick	from
Casing Material and Joints (Welded, T and C, etc.):	A53B (WELDED)						
Weight at Depth Interval:	33.4 lbs/foot	0	' to 135'	lbs/foot	0	' to	
Weight at Depth Interval:	lbs/foot	' to		lbs/foot	' to		
Screen Material and Casing to Screen Joint (Welded, T and C, K Packer, etc.):	JOHNSON GALV. V-WIRE (WELDED)						
Screen Slot Size in Inches and Depth Interval or N/A if none:	0.060"	from 135'	to 165'	from	' to		

Annular Space Material Including Filter Pack Material, If Used:

Material and Depth Interval:	BENTONITE CUTTINGS	0	' to 115'	/	0	' to
------------------------------	--------------------	---	-----------	---	---	------

Applicant Signature

By signing this form, I certify that to the best of my knowledge, all information in the application is accurate and correct. I understand that unsigned or incomplete applications will not be approved.

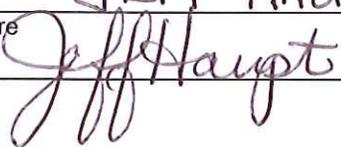
Name - Print	JEFF HAUPT		Select One:
Signature			<input type="radio"/> Owner <input checked="" type="radio"/> Agent of Owner
Company	HAUPT WELL DRILLING INC		Date
			7/7/2016

2. Trempealeau (SE)-Caledonia (W)

T.18N. - R.9W.

©2006 cloud cartographics, Inc. st. cloud, mn 56301

See Page 18

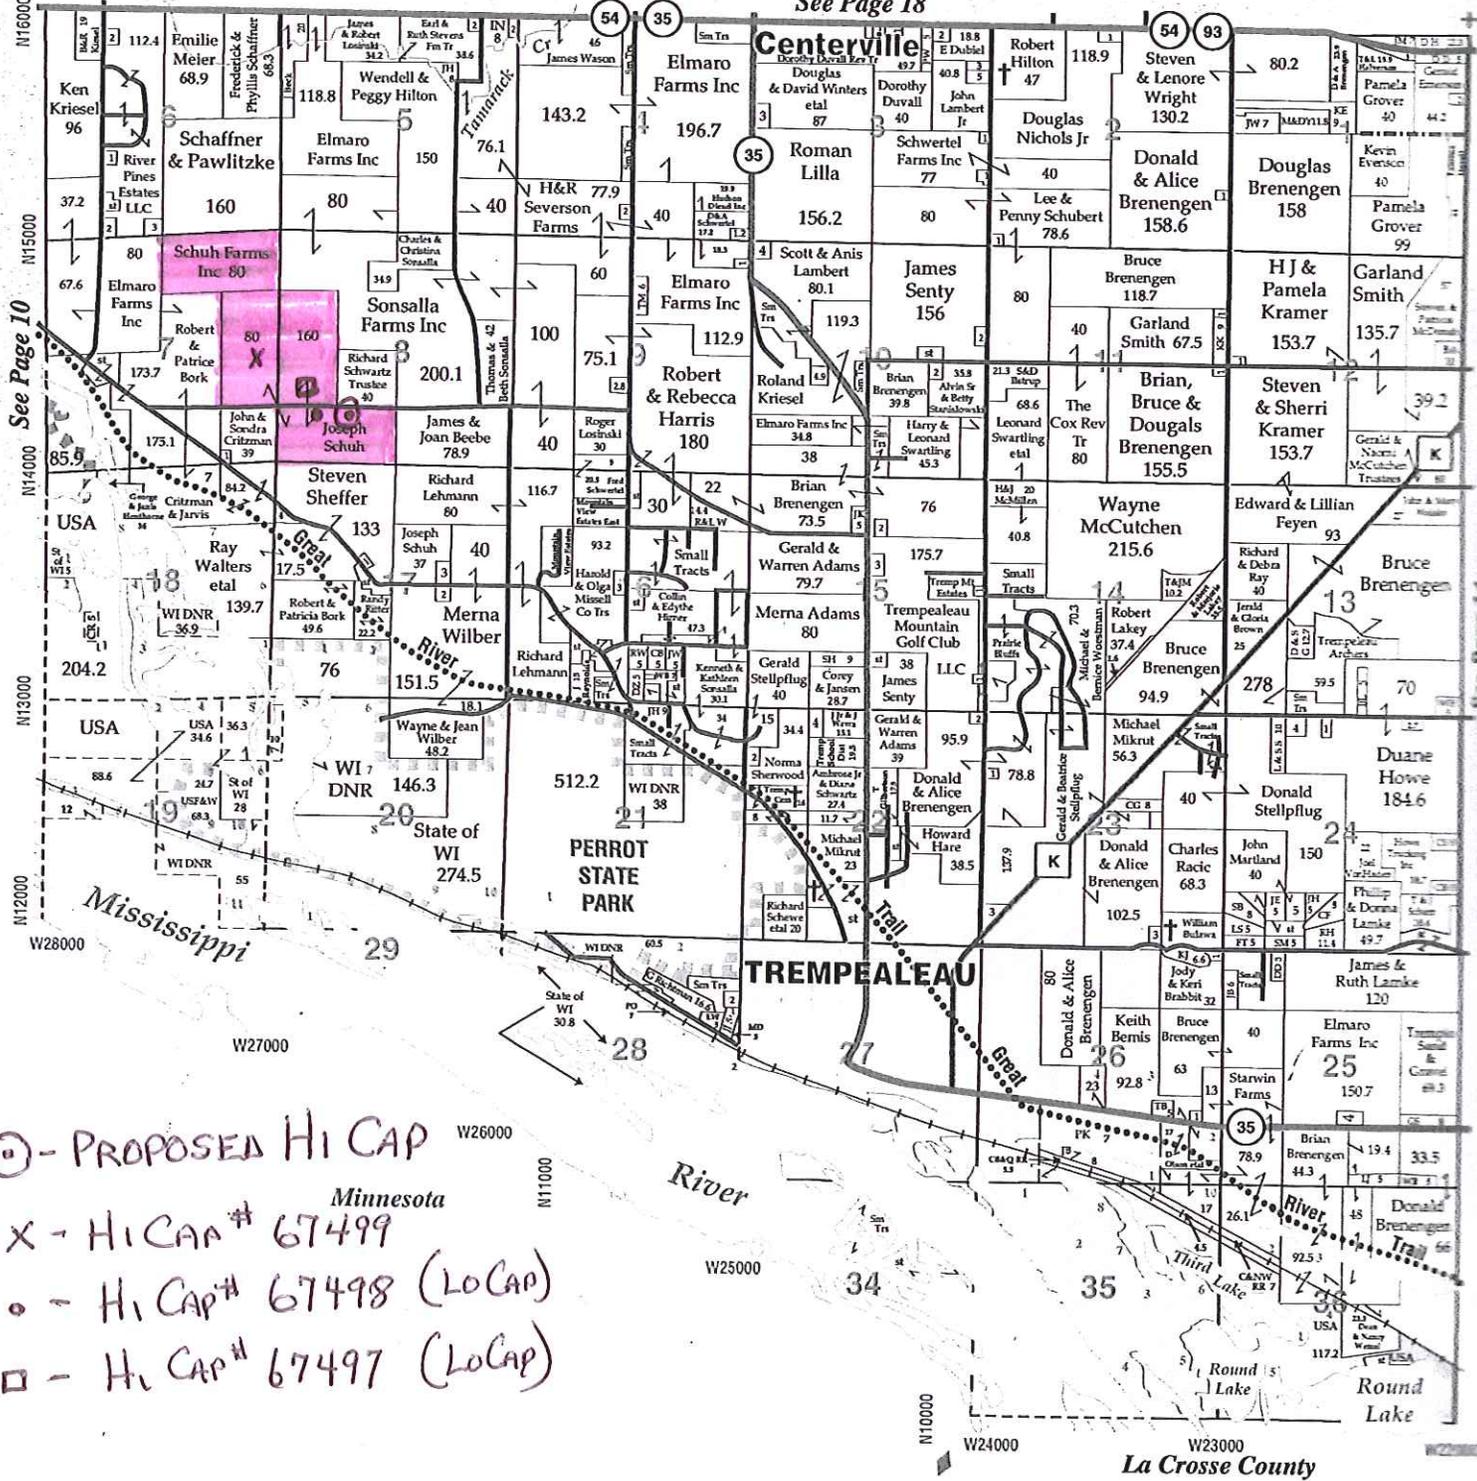

- ⊙ - PROPOSED HI CAP
- X - HI CAP # 67499
- - HI CAP # 67498 (LOCAP)
- - HI CAP # 67497 (LOCAP)



Citizens First Bank

Banking with people.

VIROQUA
101 South Main
Viroqua, WI 54686
608-637-3133

VIOLA
102 W Commercial St
Viola, WI 54664
608-627-1491

SPARTA
124 North Court Street
Sparta, WI 54656
608-269-2126

TREMPEALEAU
24050 Third Street
Trempealeau, WI 54661
608-534-6335

Trempealeau, WI