

Nonpressurized Conduits

A fact sheet for drillers and pump installers

The ch. NR 812 Wis. Adm. Code compliance of a nonpressurized conduit (NPC) depends on several factors; the date it was installed, the type of pump serving the well (offset or submersible), how many housing units the well serves and in some cases, the results of a pressure test.

SOME IMPORTANT FACTS ABOUT NONPRESSURIZED CONDUITS (NPC):

- **NPCs INSTALLED ON OR AFTER FEBRUARY 1, 1991** – Suction lines (discharge lines connected to an offset pump) are not allowed in a NPC that was installed on or after February 1, 1991. Submersible pump discharge lines may be contained in a NPC that was installed before or after February 1, 1991. However, a submersible pump discharge line installed in a NPC on or after February 1, 1991 requires approval through a variance. (See NR 812.31).
- **NPCs INSTALLED BEFORE FEBRUARY 1, 1991** – NPCs installed before February 1, 1991 must serve a maximum of 3 residential units and pass a pressure test (only required if the well is entered for pump work) to remain in service. The NPC must also be at least four inches in diameter, have an approved well seal at the basement end, meet the casing material requirements of NR 812.17 and the lowest point must be at least six inches above the floor.
- **WHEN TO CONDUCT A PRESSURE TEST** – A pressure test of a NPC is required when a well is entered for pump work, the NPC is for a pre-February 1, 1991 suction line or the NPC has a submersible discharge line passing through it and the owner wants to keep it in service. If the NPC fails the pressure test it must be removed and replaced. The replacement depends on what type of pump the well has. On an offset pump the NPC must be replaced with a pressurized line. On a submersible pump the NPC must be replaced with a buried discharge line.
 - A pressure test method for NPC is not defined in ch. NR 812 Wis. Adm. Code. When a pressure test of an NPC is done, the DNR recommends that the professional conducting the test set up and record the results in a format that shows that a sufficient and reliable test was performed. A similar test for a pitless adapter is described in s. NR 812.31(2)(c) Wis. Adm. Code.
 - A pressure test of a NPC is not typically part of a real estate transfer well inspection since the well is not entered for pump work.
- **SERVICE TO > 3 RESIDENTIAL UNITS** – All NPCs (no matter when it was installed) that serve > 3 residential units (apartments or homes) must be completely cut off below where the NPC connects to the well casing. On an offset pump the NPC must be replaced by pressurized line. On a submersible pump the NPC must be replaced by a buried discharge line.

This fact sheet and flow chart do not replace or supersede specific code language for nonpressurized conduit, which is found in ss. NR812.17, NR812.31, NR812.36(3)(b)1, NR812.42(6), and NR812.42(11)(e) Wis. Adm. Code

This document is intended solely as guidance and does not contain any mandatory requirements except where requirements found in statute or administrative rule are referenced. Any regulatory decisions made by the Department of Natural Resources in any matter addressed by this guidance will be made by applying the governing statutes and administrative rules to the relevant facts.

The Wisconsin Department of Natural Resources provides equal opportunity in its employment, programs, services, and functions under an Affirmative Action Plan. If you have any questions, please write to Equal Opportunity Office, Department of Interior, Washington, D.C. 20240.

*This publication is available in alternative format (large print, Braille, audiotape, etc.) upon request.
Please call 608-266-1054 for more information.*




DOES A NONPRESSURIZED CONDUIT COMPLY WITH ch. NR 812 Wis. Adm. Code? Check the flowchart on the next page.



Wisconsin Department of Natural Resources
101 S. Webster St., Box 7921
Madison, WI 53707-7921
(608) 266-1054



Nonpressurized Conduit Flowchart

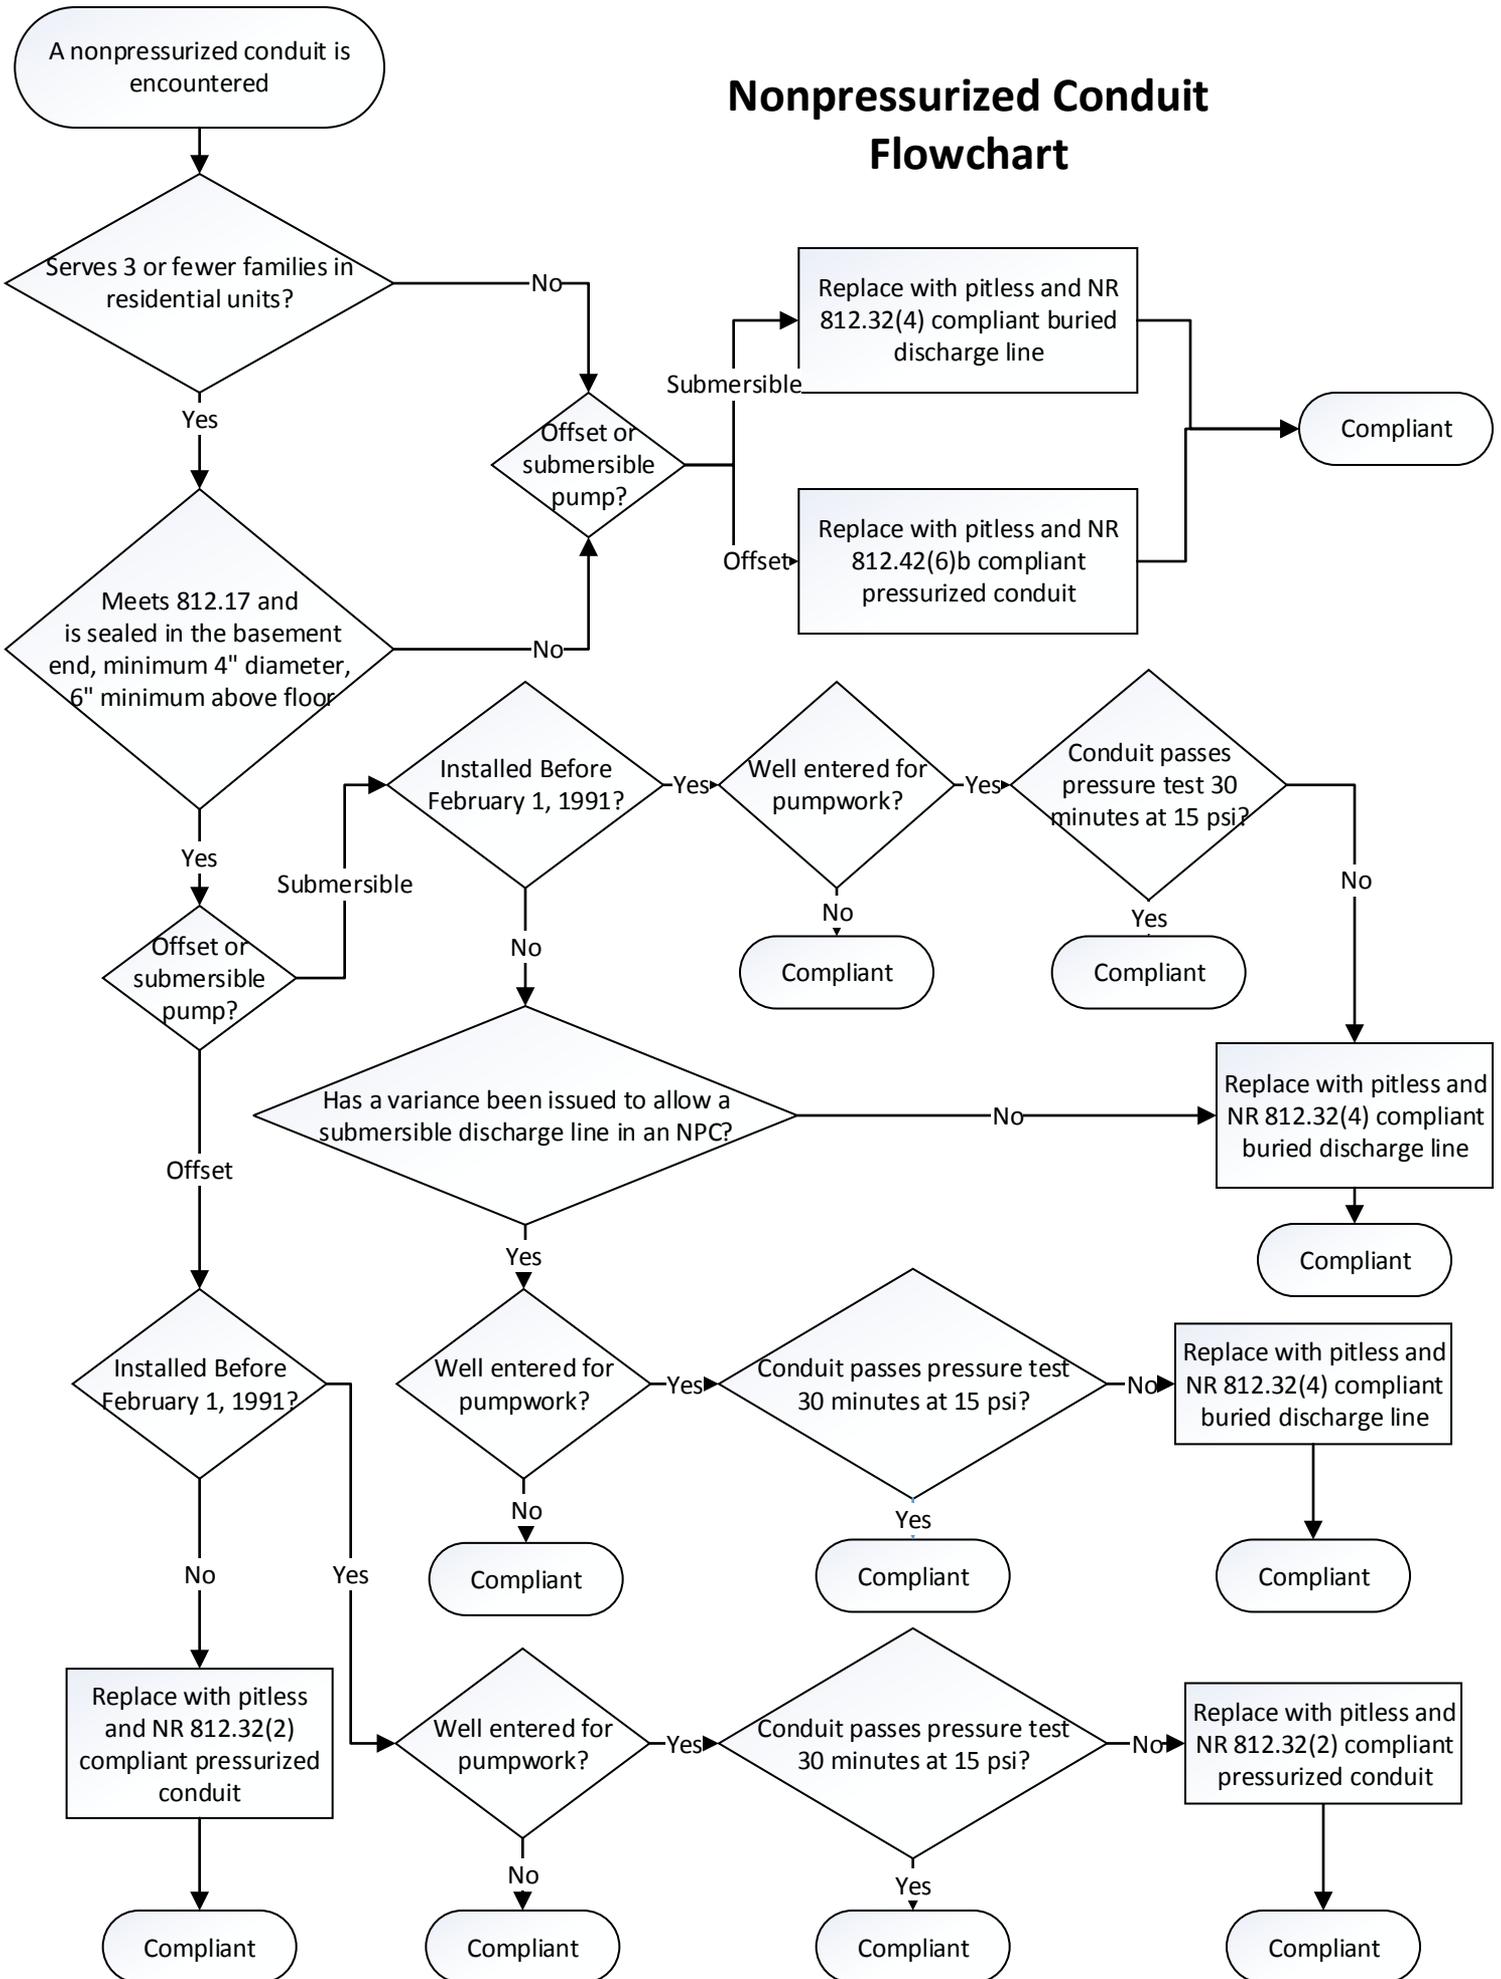



WISCONSIN DEPARTMENT OF NATURAL RESOURCES NOTICE OF FINAL GUIDANCE & CERTIFICATION

Pursuant to ch. 227, Wis. Stats., the Wisconsin Department of Natural Resources has finalized and hereby certifies the following guidance document.

DOCUMENT ID

DG-19-0012

DOCUMENT TITLE

PUB DG-087 - Nonpressurized Conduits - a fact sheet for drillers and pump installers

PROGRAM/BUREAU

Drinking Water and Groundwater Program

STATUTORY AUTHORITY OR LEGAL CITATION

NR 812, Wis. Adm. Code

DATE SENT TO LEGISLATIVE REFERENCE BUREAU (FOR PUBLIC COMMENTS)

12/02/2019

DATE FINALIZED

01/23/2020

DNR CERTIFICATION

I have reviewed this guidance document or proposed guidance document and I certify that it complies with sections 227.10 and 227.11 of the Wisconsin Statutes. I further certify that the guidance document or proposed guidance document contains no standard, requirement, or threshold that is not explicitly required or explicitly permitted by a statute or a rule that has been lawfully promulgated. I further certify that the guidance document or proposed guidance document contains no standard, requirement, or threshold that is more restrictive than a standard, requirement, or threshold contained in the Wisconsin Statutes.

A handwritten signature in black ink, appearing to be 'Stanley'.

1/24/2020

Signature

Date