


Facility: Bagley Wastewater Treatment Facility

Years of CMAR Data: 2002 - 2003

Linear Equation used for Trend Line: $y = 0.000074 * x + 0.85$

Monthly Average Influent Flow Year Trend Line Intersects Design Flow: 2059

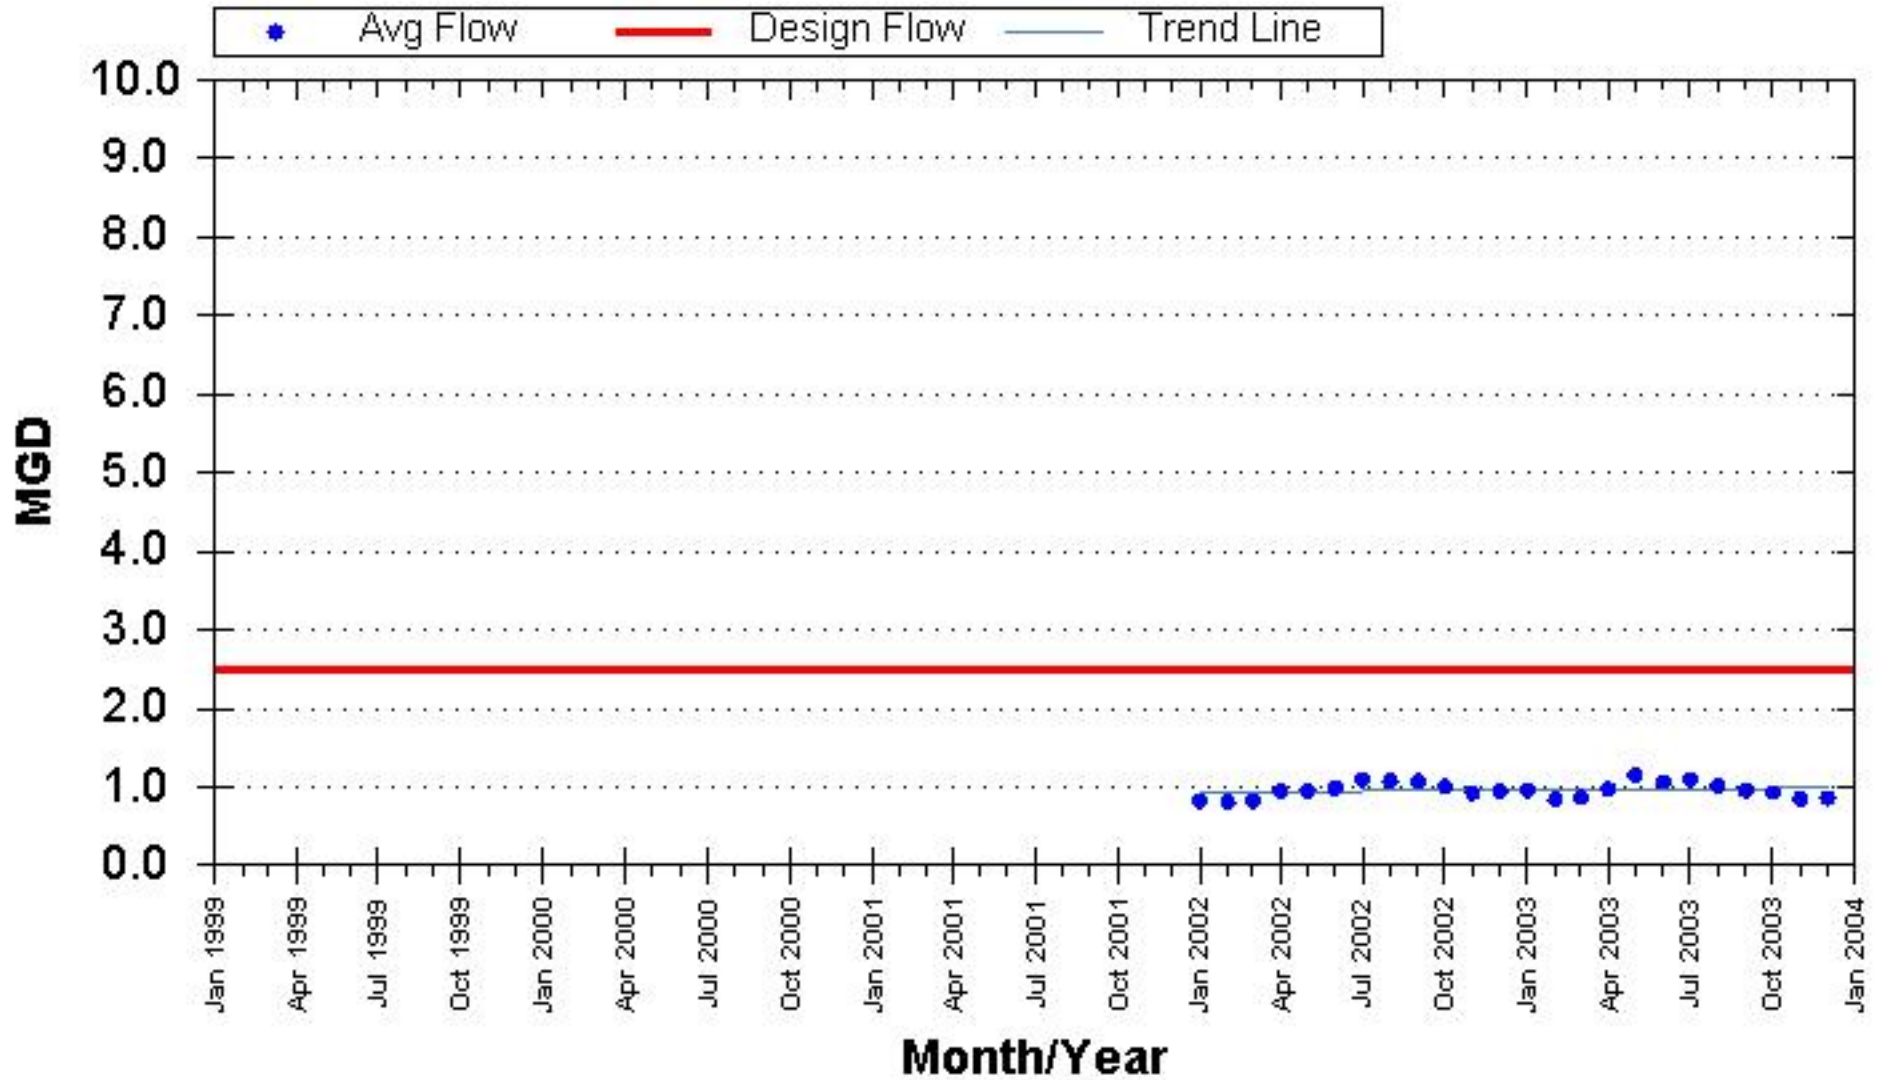

Facility: Bagley Wastewater Treatment Facility

Years of CMAR Data: 2002 - 2003

Linear Equation used for Trend Line: $y = 0.557776 * x + 832.38$

Influent BOD or CBOD Loading Year Trend Line Intersects Design (C)BOD: 2010

