

Lily Creek at Good Hope Rd

Road Salt Monitoring Data Summary

February –December 2011



Photo courtesy of Jim Beecher

Volunteer: Chris Hitch

Specific conductance summary:

- 10 measurements taken
- Minimum: 950 $\mu\text{S}/\text{cm}$ on 8/14/2011
- Maximum: 3300 $\mu\text{S}/\text{cm}$ on 3/1/2011 and 3/12/2011
- Mean: 1808 $\mu\text{S}/\text{cm}$

Chloride (Cl⁻) summary:

- 6 samples collected
- Minimum: 188 mg/L 9/20/2011
- Maximum: 539 mg/L 3/1/2011
- Mean: 302 mg/L

Specific conductance ranges at which to collect grab samples in 2012 for this site:

- Mid-level: 2000-3000 $\mu\text{S}/\text{cm}$
- High-level: >3000 $\mu\text{S}/\text{cm}$


EPA Acute and Chronic Exceedences for Chloride¹:

The EPA acute chloride standard of 860 mg/L was not exceeded at this site.

However, the EPA chronic chloride standard of 230 mg/L was met or exceeded six times:

- 230 mg/L on 6/8/2011 (measured)
- 242 mg/L on 3/29/2011 (measured)
- 262 mg/L on 4/3/2011 (measured)
- 353 mg/L on 2/15/2011 (measured)
- 539 mg/L on 3/1/2011 (measured)
- 834 mg/L on 3/12/2011 (calculated)²

Results Over Time²:

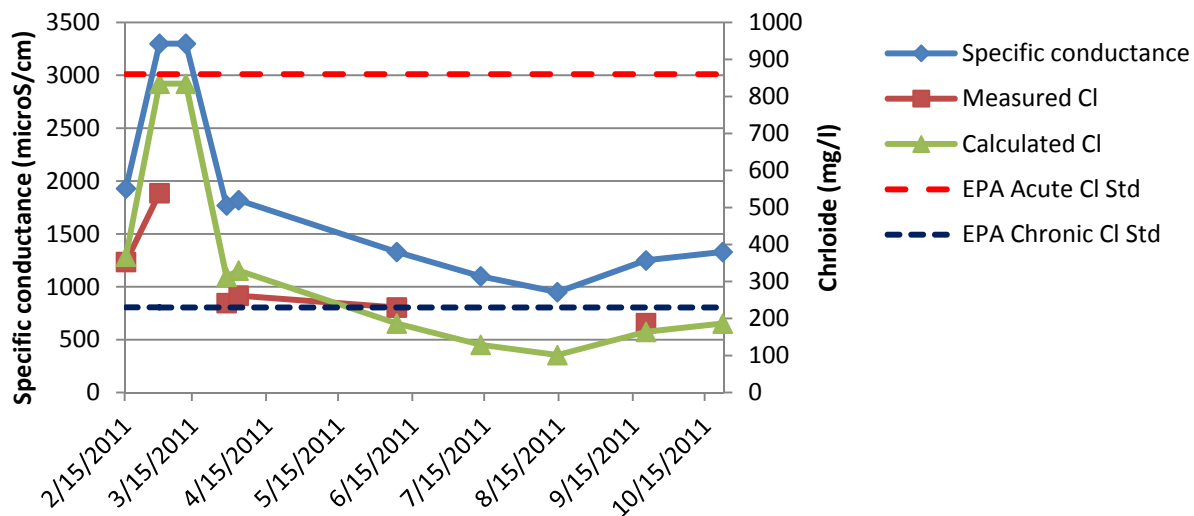

¹ Acute standard: The one-hour average should not exceed 860 mg/L more than once every three years. Chronic standard: The four day average should not exceed 230 mg/L more than once every three years. Source: EPA. 1988. Ambient Water Quality Criteria for Chloride. EPA 440/6-88-001.

² Calculated chloride: When $\text{SC} > 1540 \mu\text{S}/\text{cm}$ was $\text{Cl} = 0.3441 * \text{SC} - 291$, $\text{adjR}^2 = 0.98$; when $\text{SC} \leq 1540 \mu\text{S}/\text{cm}$ was $\text{Cl} = 1.044 * (\exp(0.001609 * \text{SC} + 3.046))$, $\text{adj R}^2 = 0.65$. Equations based on data from both Madison and Milwaukee.